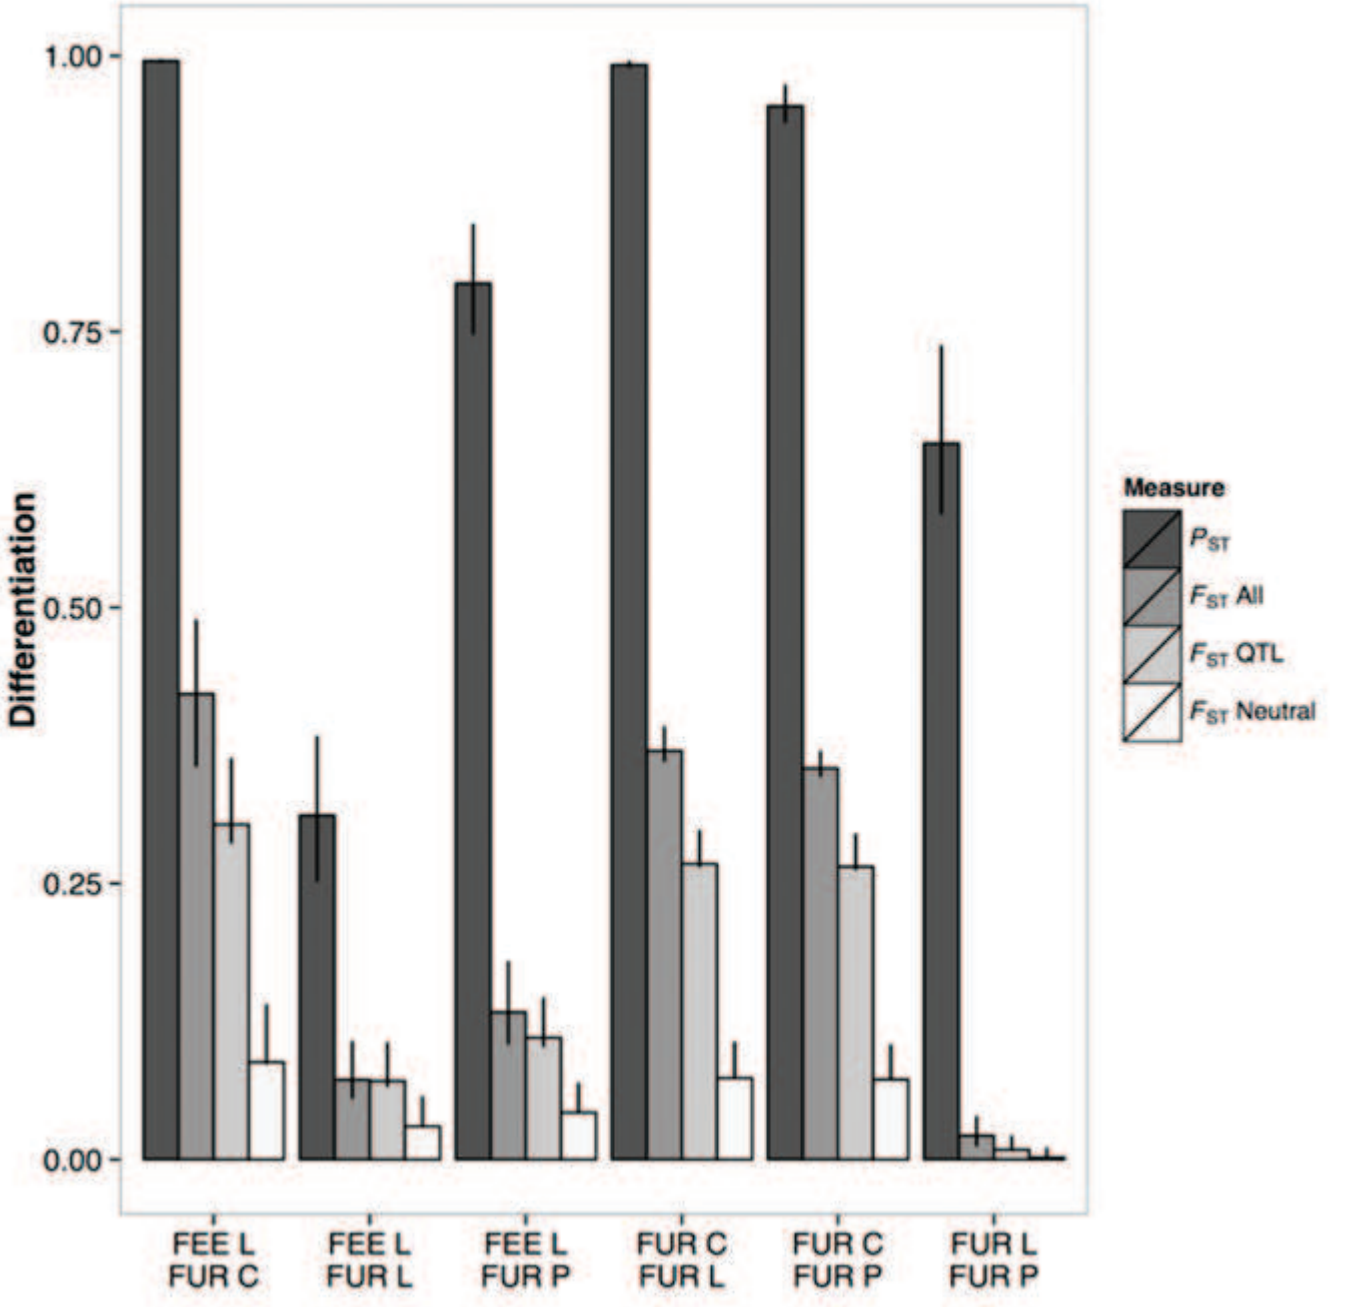
1.00
0.75
0.50
0.25
0.00
Differentiation
FEE L
FUR C
FEE L
FUR L
FEE L
FUR P
FUR C
FUR L
FUR C
FUR P
FUR L
FUR P
Measure
P_{ST}
F_{ST} All
F_{ST} QTL
F_{ST} Neutral